
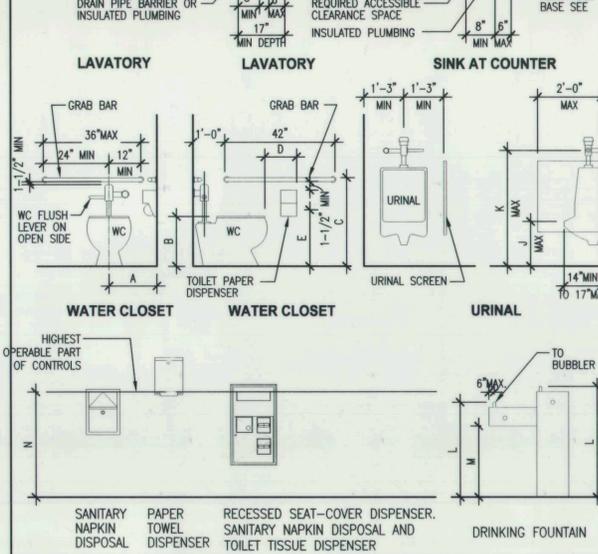
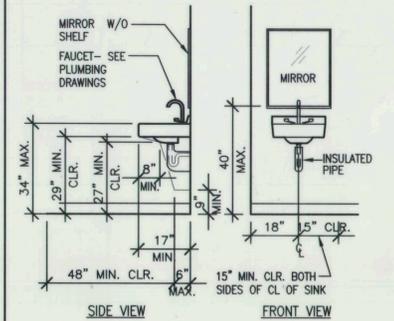
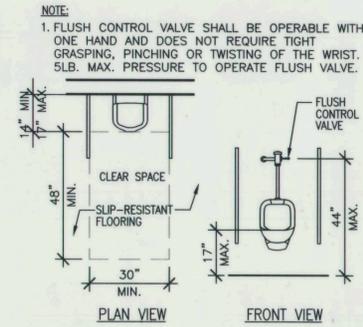


Spout Height and Knee Clearance

SEE HANDICAPPED ACCESS. NOTES ON ACCESSIBILITY SHEET A-0.1, A-0.2, A-0.3 FOR ADDITIONAL NOTES.

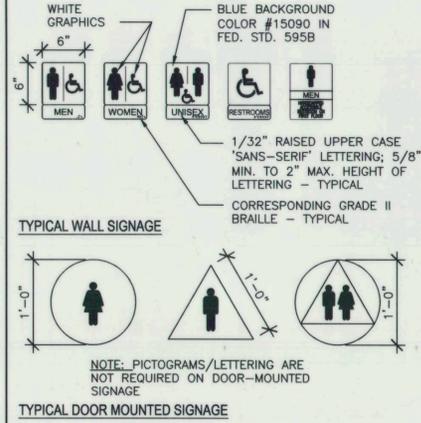

DRINKING FOUNTAIN SCALE: 10 N.T.S.

RESTROOM SIGNAGE SCALE: 7 1"=1'-0"

TYP. ACCESS. URINAL SCALE: 4 3/8"=1'-0"

TYP. ACCESS. LAVATORY SCALE: 1 3/8"=1'-0"




REACH RANGES SCALE: 11 3/8"=1'-0"

RESTROOM SIGNAGE SCALE: 8 3/8"=1'-0"

ACCESS. STALL DOOR SCALE: 5 3/8"=1'-0"



TYP. ACCESS. TOILET SCALE: 2 3/8"=1'-0"

DRINKING FOUNTAIN NOTES:
 1. DRINKING FOUNTAINS ARE TO BE LOCATED WITHIN ALCOVES
 1.1. ALCOVES SHALL BE A MINIMUM OF 32" WIDE BY 18" DEEP
 1.2. PROTRUDING OBJECTS LOCATED IN ALCOVE MAY PROJECT 4" MAX. BEYOND ALCOVE.
 2. OR WING WALLS SHALL BE PROVIDED ON EACH SIDE OF THE WATER FOUNTAIN PROJECTING AT LEAST AS FAR AS THE DRINKING FOUNTAIN.
 2.1. BOTTOM OF WING WALL SHALL BE WITHIN 6" OF THE SURFACE OF THE PATH OF TRAVEL.
 2.2. THERE SHALL BE A MINIMUM OF 32" BETWEEN WING WALLS.
 3. THE DRINKING FOUNTAIN SHALL BE A MINIMUM OF 18" DEEP.
 3.1. DRINKING FOUNTAIN SHALL HAVE A MINIMUM KNEE SPACE (MEASURED FROM FRONT EDGE) OF 27" HIGH BY 8" DEEP.
 3.2. DRINKING FOUNTAIN SHALL HAVE A MINIMUM TOE CLEARANCE (MEASURED FROM FRONT EDGE) OF 9" HIGH BY 17" DEEP.
 3.3. LEVER OR PUSH BAR SHALL BE LOCATED WITHIN 6" OF THE FRONT EDGE OF THE FOUNTAIN AND SHALL REQUIRE A FORCE NOT EXCEEDING 5 lbf. TO ACTIVATE CONTROLS.
 4. THE BUBBLER OUTLET HEIGHT SHALL BE LOCATED 36" MAXIMUM FROM THE FLOOR AND SHALL HAVE A MINIMUM STREAM HEIGHT OF 4" AND SHALL BE PARALLEL TO THE FRONT EDGE OF THE DRINKING FOUNTAIN.

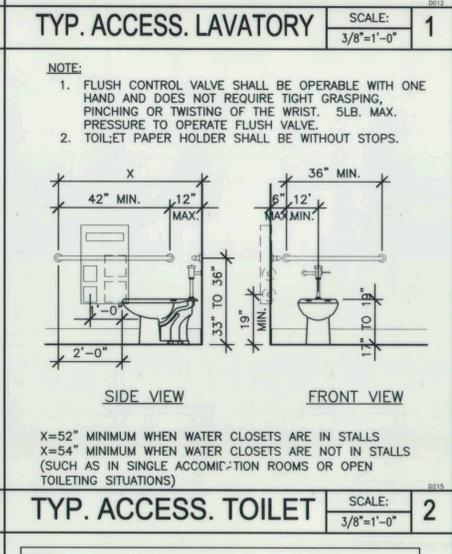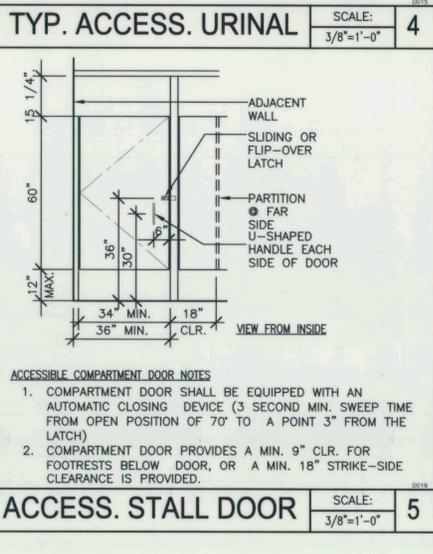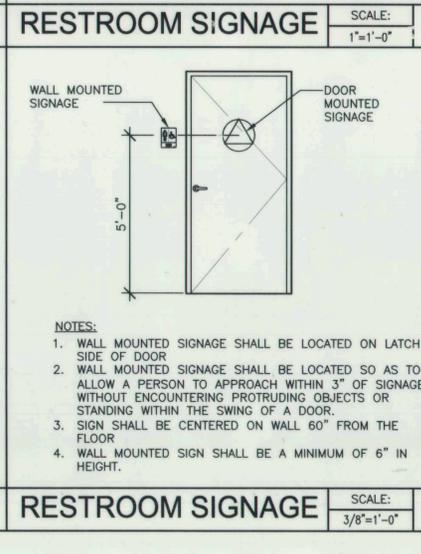

FIXTURE MOUNTING HEIGHTS SCALE: 15 3/8"=1'-0"

KEY	DESCRIPTION	DIMENSIONS	
		ADULT	ACCESSIBLE
A	WATER CLOSET CENTERLINE FROM WALL	18"	
B	TOILET SEAT HT (TOP OF SEAT)	17"-19"	
C	GRAB BAR HT (CENTERLINE)	33"	
D	TOILET PAPER DISPENSER FROM WC	12"	
E	TOILET PAPER DISPENSER HT	19" MIN	
F	HAND SOAP DISPENSER & MIRROR	40" MAX	
G	LAVATORY/SINK (BASE CAB TOP OF RIM HT)	34" MAX	
H	LAVATORY/SINK (BASE CAB KNEE CLR)	27" MIN	
J	URINAL LIP HT	17" MAX	
K	URINAL FLUSH HANDLE HT	44" MAX	
L	DRINKING FOUNTAIN BUBBLER HT	36"	
M	DRINKING FOUNTAIN KNEE CLR	27" MIN	
N	ACCESSORY OPERATION REACH	40"	

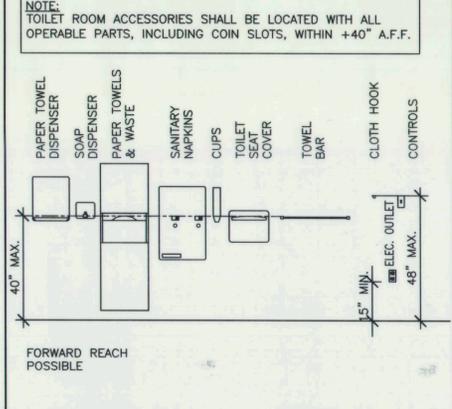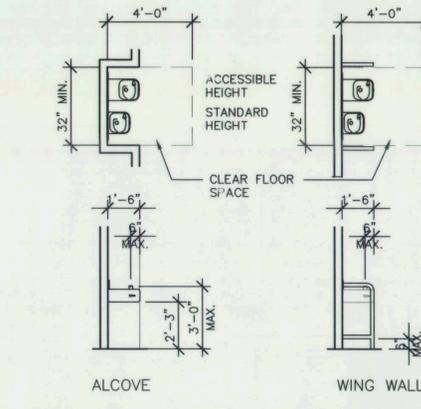

DRINKING FOUNTAIN SCALE: 9 1/4"=1'-0"

INTERNATIONAL ACCESSIBILITY SYMBOL SCALE: 6 1"=1'-0"

TOILET RM. ACCESSORIES SCALE: 3 3/8"=1'-0"



inc.
ALEXANDER + HIBBS, AIA, INC.
 Architecture and Planning
 1200 N. JEFFERSON ST. SUITE A
 ANAHEIM, CALIFORNIA 92807
 (714) 630-3686

PLANS PREPARED BY:
WILLDAN outstanding people results
 Landscape architecture
 13101 CROSSROADS PARKWAY NORTH, SUITE 405
 INDUSTRY, CA 91746-3497
 (562) 908-6200
 UNDER THE SUPERVISION OF:
 05/04/12

BENCH MARK:
 NO. _____ ELEV. _____
 DATE ADJ. _____ QUAD. _____
 SEE TOPOGRAPHIC SURVEY MAP
 ROBERT RYAN PARK
 PREPARED BY
 MCGEE SURVEYING CONSULTING
 805.964.3520

REVISIONS			
NO.	DESCRIPTION	APP.	DATE

CITY OF RANCHO PALOS VERDES
RYAN PARK RESTROOMS IMPROVEMENT AND ACCESSIBILITY COMPLIANCE
ACCESSIBILITY DETAILS
 DRAWN BY: _____
 DESIGNED BY: _____
 CHECKED BY: _____
 SHT. 9 OF 20 SHTS
 PLAN NO. **A-1.5**