


LEGEND:

- FUTURE PHASE BUILDINGS
- EXISTING BUILDINGS
- FIRE TRUCK ACCESS ROUTE WITH ALL TURNING RADII TO COMPLY WITH COUNTY OF LOS ANGELES FIRE DEPARTMENT FIRE TRUCK TURNING RADIUS REQUIREMENTS: 32' MINIMUM ON CENTERLINE RADIUS FOR ALL REQUIRED FIRELANES. PROVIDE FIRE LANE SIGNAGE AS REQ'D
- PROPOSED FIRE HYDRANT
- FIRE HOSE DIAGRAMMED LENGTH TO ACCESS ROUTE
- DRIVEABLE GRASS PAVE TO SUPPORT A FIRETRUCK AS REQUIRED BY LA COUNTY FIRE AUTHORITY


NOTE: THE REQUIRED FIRE FLOW FOR THIS DEVELOPMENT IS 3000 GALLONS PER MINUTE FOR 3 HOURS. THE WATER MAINS IN THE STREET FRONTING THIS PROPERTY MUST BE CAPABLE OF DELIVERING THIS FLOW AT 20 POUNDS PER SQUARE INCH RESIDUAL PRESSURE.

INSTALL PUBLIC AND/OR ON-SITE AND/OR VERIFY OR UPGRADE 6"x4"x24" FIRE HYDRANTS, CONFORMING TO AWWA STANDARD C503-75 OR APPROVED, EQUAL. ALL INSTALLATIONS MUST MEET FIRE DEPARTMENT SPECIFICATIONS. FIRE HYDRANT SYSTEMS MUST BE INSTALLED IN ACCORDANCE WITH THE UTILITY MANUAL OF ORDINANCE 7834 AND ALL INSTALLATIONS MUST BE INSPECTED AND FLOW TESTED PRIOR TO FINAL APPROVAL.


1 FIRE APARATUS ACCESS ROAD
1"=30'-0"

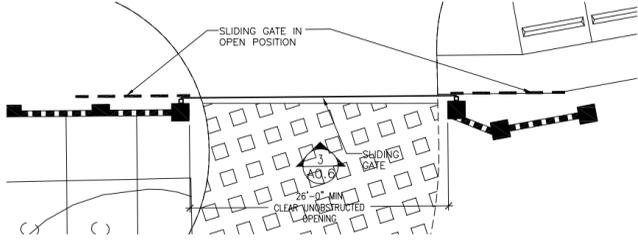


2 FIRETRUCK GATE ACCESS
1/8"=1'-0"

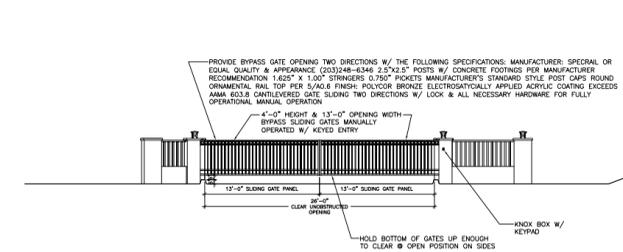

3 FIRETRUCK GATE ELEVATION
1/8"=1'-0"

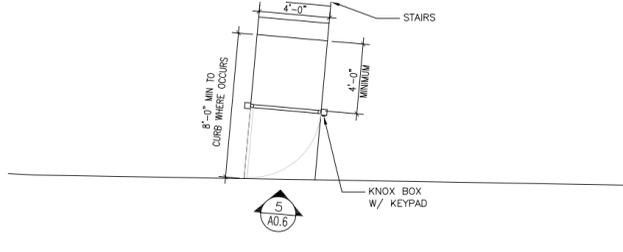

4 FIRE GATE PEDESTRIAN ACCESS
1/4"=1'-0"

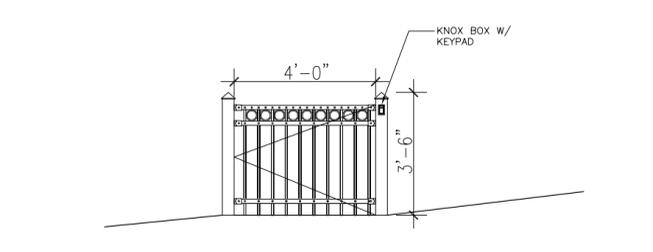

5 FIRE GATE PEDESTRIAN ELEVATION
1/2"=1'-0"

St. John Fisher
 5448 Crest Road
 Rancho Palos Verdes, CA 90275

HYNDMAN
 ARCHITECTURE
 2611 SOUTH COAST HIGHWAY 101 - SUITE 201, CARDBEEF, CA 92007 - (760)533-2595

INTERIORS
HYNDMAN
 ARCHITECTURE
 2611 SOUTH COAST HIGHWAY 101 - SUITE 201, CARDBEEF, CA 92007 - (760)533-2595

REVISIONS:

FIRE APARATUS ACCESS
 Date: OCTOBER 2008
 Sheet: A0.6
 Of: 6 Sheets

Z:\01Proj\2006\0605-Palos Verdes\CUP\A0.6-FirePhaseOne.dwg, 11/07/2008 4:13:17 PM, Copyright Hyndman & Hyndman Architecture, <<Mr. G>>