
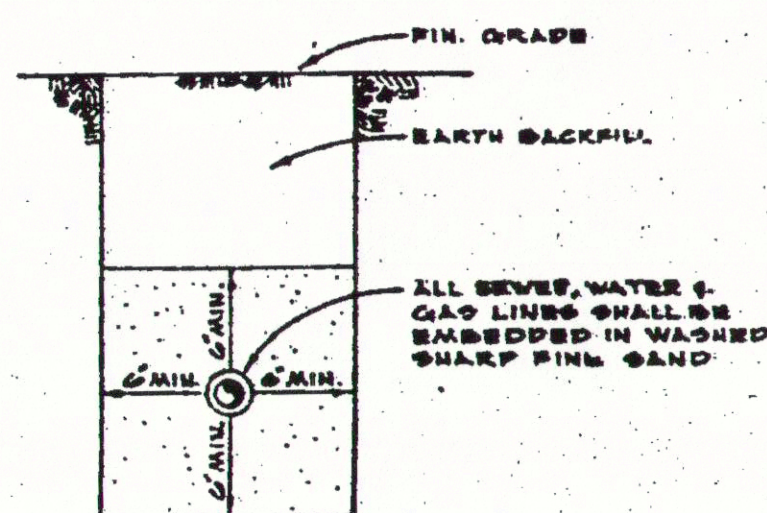



[illegible]

**PIPE TRENCH DETAIL**  
NO SCALE DETAIL

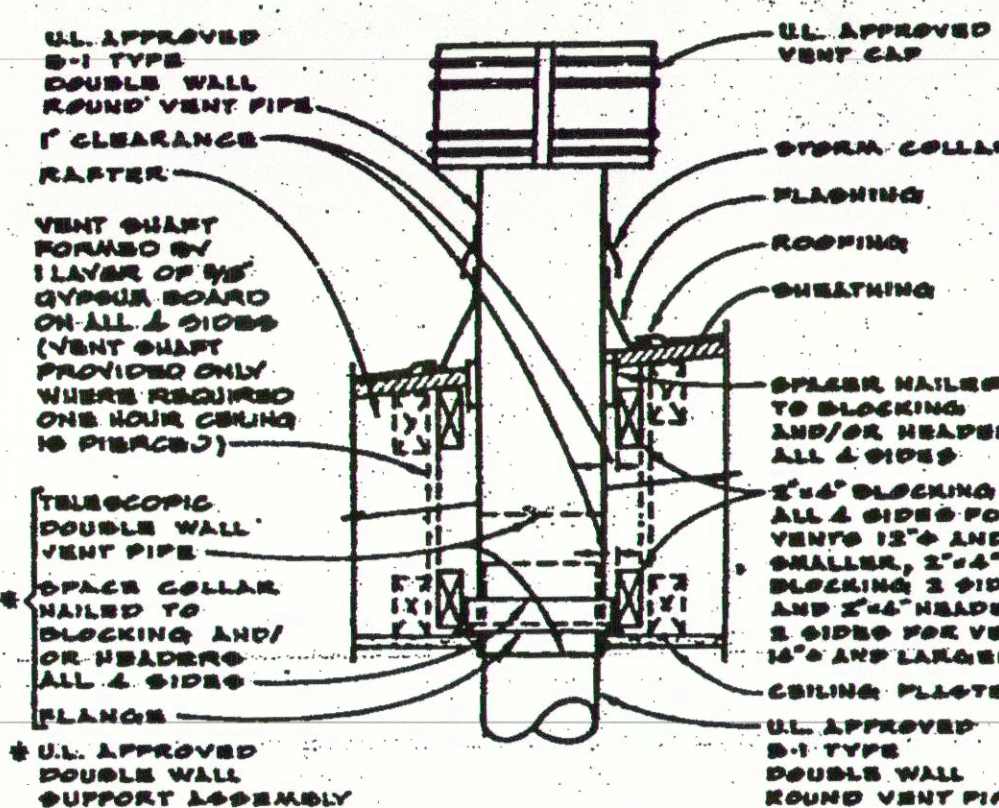


DETAIL (MI)  
NO SCALE (B)


1. ALL SHUT-OFF VALVES OUTSIDE THE BUILDINGS SHALL BE INSTALLED IN CONCRETE BOXES WITH THE NAME OF THE SERVICE CONSPICUOUSLY CAST IN COVER.
2. ALL HOSE BIBBS AND GARDEN HOSE VALVES SHALL BE LOCATED 18" ABOVE FINISHED FLOOR OR FINISHED GRADE.
3. PLUGGED TIES AND PLUGGED WYES SHALL BE LINE SIZES UNLESS OTHERWISE NOTED.
4. FOR ALL BENCH MARKS SEE CIVIL DRAWINGS.
5. WATER METER ARROWSTOP COUPLING IS WITH HYDROTRAC AND IS TO BE USED FOR REFERENCE ONLY.
6. LOCATIONS OF EXISTING LINES ARE ASSUMED AND SHALL BE VERIFIED BY HYDROTRAC LOCATING EQUIPMENT.

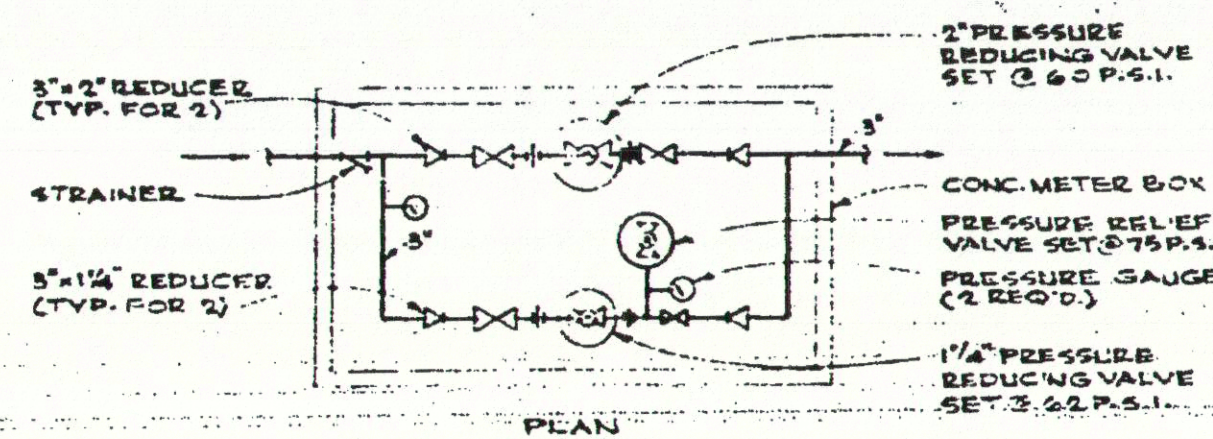


Environ Biol Fish (2015) 98:1031–1045

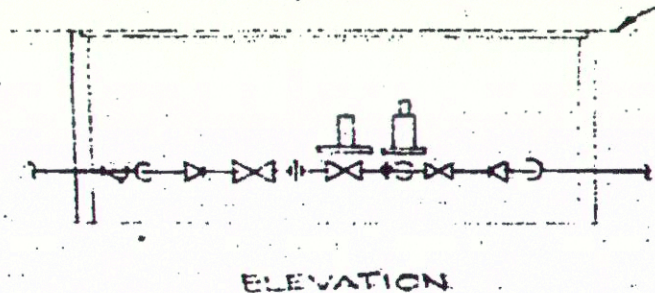

DETAIL  
NO SCALE

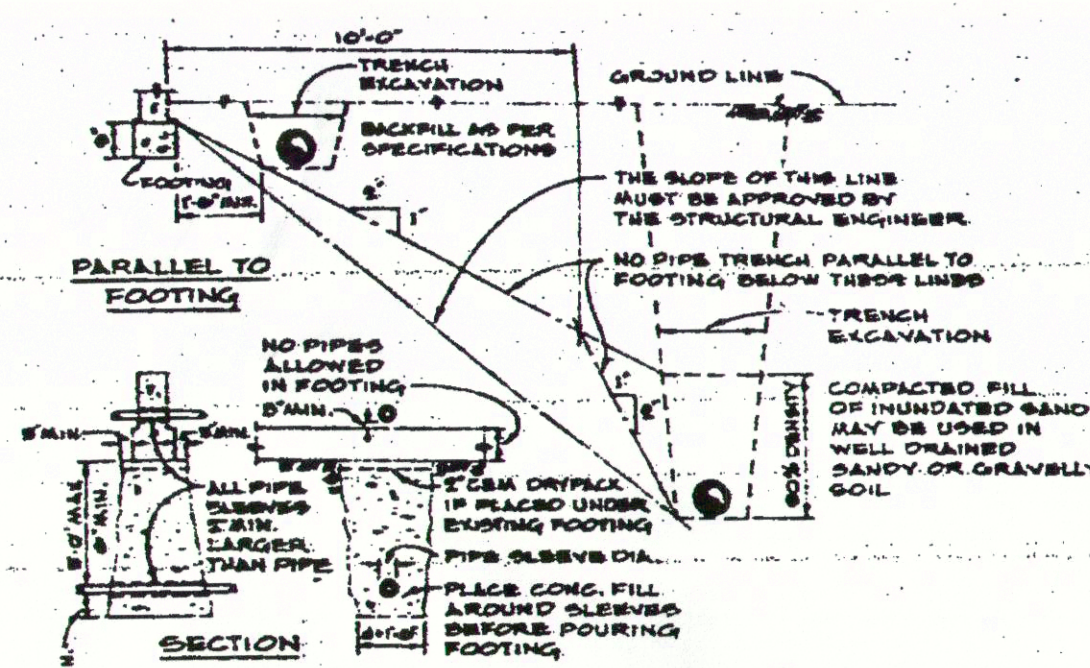


## TYPICAL PIPE INSTALLATIONS AT CONCRETE FOOTINGS

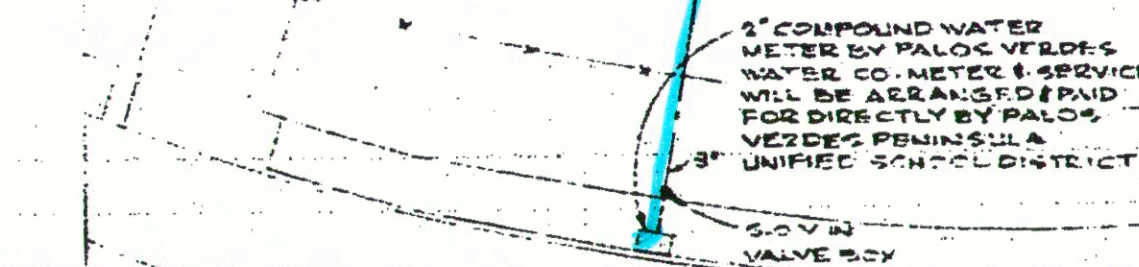


€ PIRATE DRIVE

|                                         |          |
|-----------------------------------------|----------|
| C.W. DEMAND                             |          |
| PROPOSED & FUT.<br>INCLUDING IRRIGATION | 190 G.P. |


| GAS DEMAND |             |
|------------|-------------|
| PROPOSED   | 841 C.F.M.  |
| FUTURE     | 985 C.F.M.  |
| TOTAL      | 1776 C.F.M. |

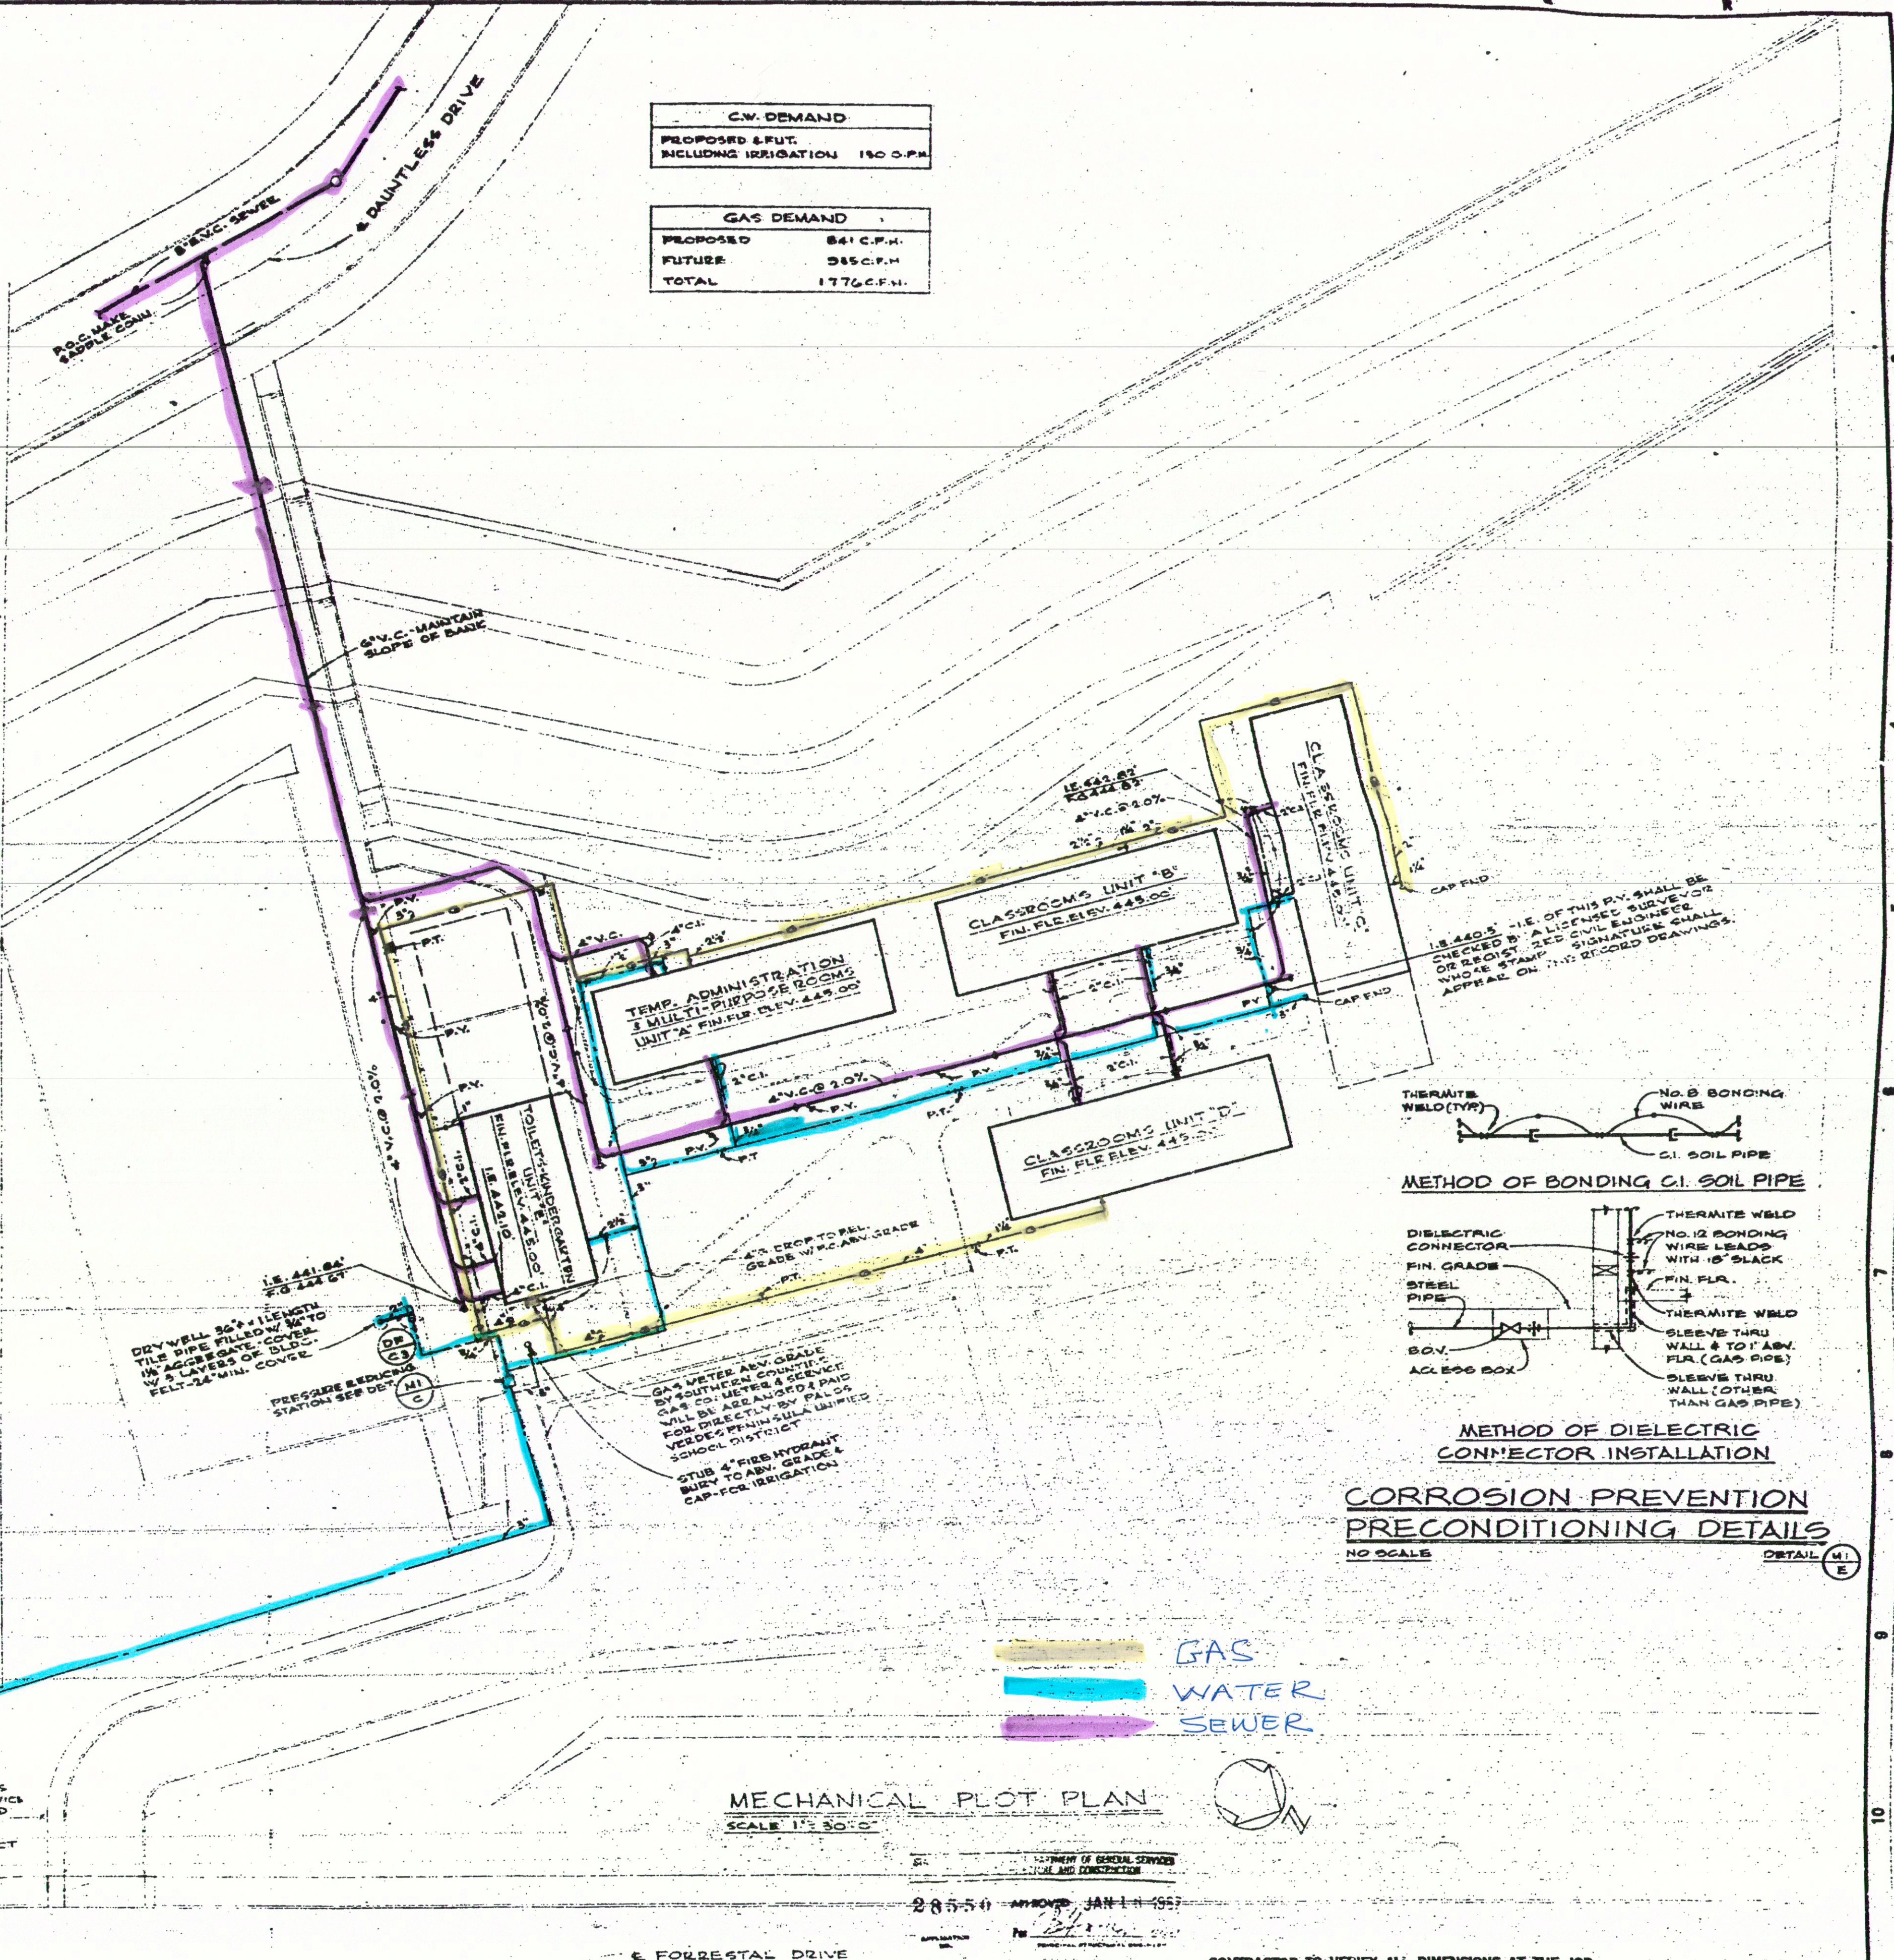

MECHANICAL PLOT PLAN  
SCALE 1" = 30' 0"

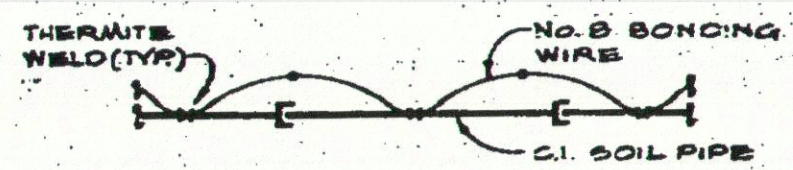

## METHOD OF BONDING C.I. SOIL PIPE

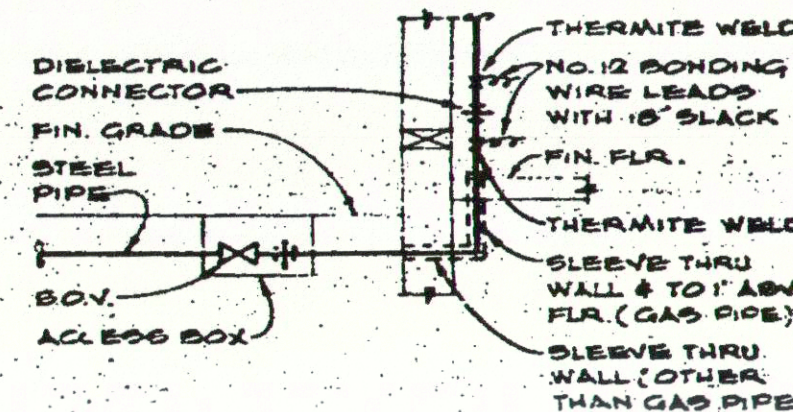

## METHOD OF DIELECTRIC CONNECTOR INSTALLATION

## CORROSION PREVENTION PRECONDITIONING DETAILS

NO SCALE DETAIL

DETAIL (41)

GAS  
WATER  
SEWER

STATE FIRE MARSHAL  
STATE OF CALIFORNIA

APPROVED *SP-5 1-16-67*

MECHANICAL PLOT PLAN

LADERA LINDA

PAVE WOODS PENNELLA UNDER S. HILLWAY AT  
ROLLING HILLS

|            |           |
|------------|-----------|
| DATE       | SHEET NO. |
| DR. BY     | MI        |
| CHECKED BY |           |
| JOB NO.    |           |
| OF SHEETS  |           |

**KISTNER, WRIGHT & WRIGHT**  
ARCHITECTS AND ENGINEERS  
LOS ANGELES, CALIFORNIA